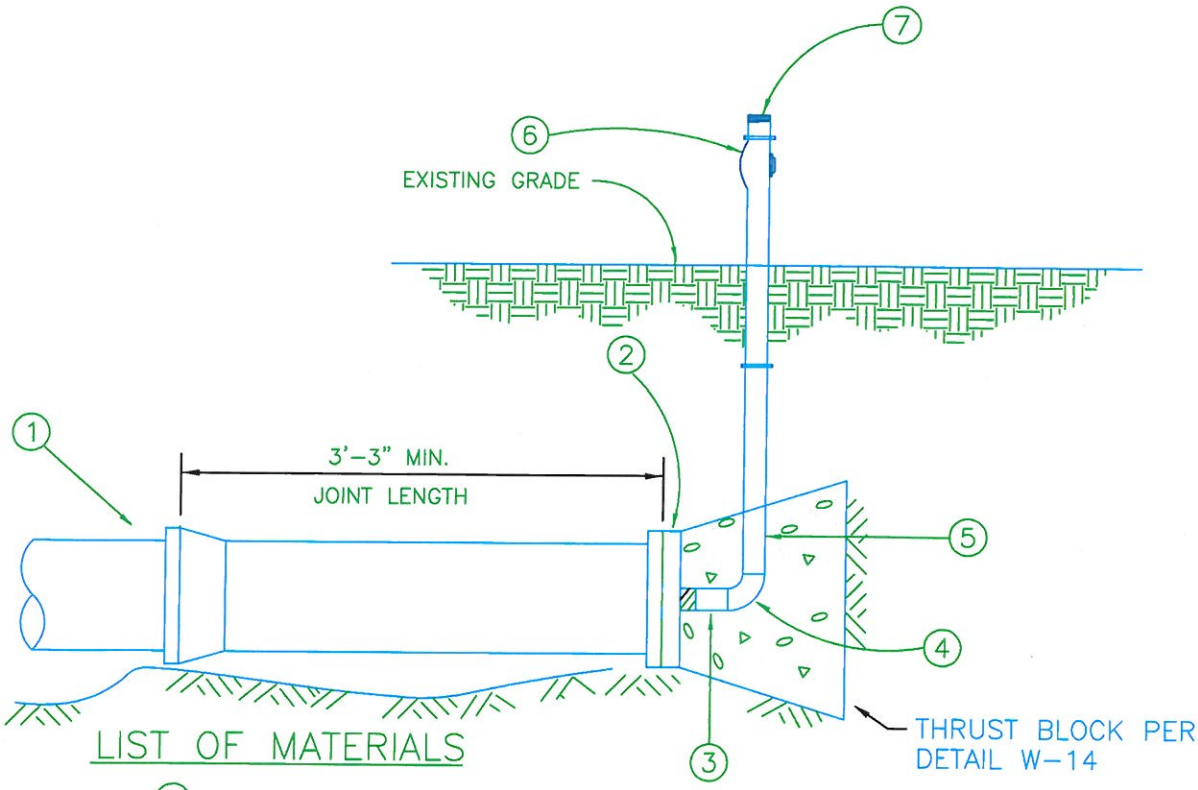

LIST OF MATERIALS

1. PIPE
2. DIP PUSH ON PLUG-TAPPED 2-1/2"
3. 2" X 6" BRASS NIPPLE
4. 2" BRASS 90° ELL
5. 2" BRASS, LENGHT AS REQUIRED
6. 2" BALL VALVE
7. 2" BRASS M.I.P X FIRE THREAD WITH CAP
8. 2" M.I.P. X SWEAT COPPER ADAPTER, AS NEEDED

SPECIAL NOTES

1. TEMPORARY BLOW-OFF ASSEMBLY REQUIRED AT ALL DEAD END LINES.
2. REMOVE RISER MATERIAL AFTER FLUSHING AND INSTALL 2" BRASS PLUG IN VALVE. LEAVE VALVE CLOSED.
3. ALL EMBEDDED PIPING SHALL BE WRAPPED WITH 10 MIL PVC TAPE.
4. ALL PARTS SHALL BE AS SPECIFIED IN STANDARD SPECIFICATIONS 15057

CONSTRUCTION TEMPORARY BLOW OFF & CHLORINATION ASSEMBLY

REVISIONS		
NO.	DATE	APPROVED

CITY OF SAN JUAN CAPISTRANO

APPROVED

WATER ENGINEERING MANAGER — DATE 9.17.2012

STD. NO. W-5

SHEET 1 OF 1

F:\CVWDSTD\W-05A