



CONSTRUCTION NOTES

1. PROVIDE AND INSTALL FIRE HYDRANTS PER SPECIFICATIONS SECTION 15139.
2. HYDRANTS TO BE PAINTED ACCORDING TO PAINT SPECIFICATIONS SECTION 09900.
3. PROVIDE SS316 "BREAK-AWAY" BOLTS AT HYDRANT FLANGE, BOLT HEAD DOWN.
4. ROTATE HYDRANT 45° WHEN ADJACENT TO POWER POLE OR STREET LIGHT POLE.
5. INSTALL WET BARREL HYDRANTS ONLY. IF SPECIFICALLY DIRECTED BY THE CITY, INSTALL A WET BARREL HYDRANT WITH A CHECK VALVE.
6. SET BACK DISTANCE PER TRAFFIC SET BACK REQUIREMENTS, OR 30" MINIMUM; WHICHEVER IS GREATER.

HYDRANT LOCATION PLANS

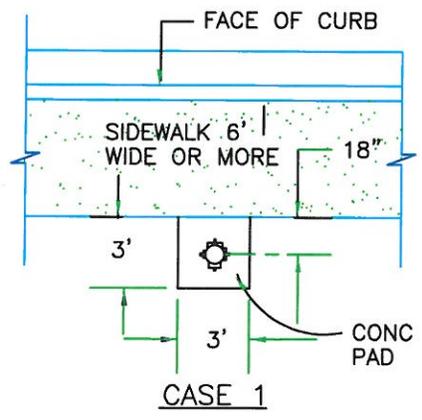

SIDEWALK ADJACENT TO CURB

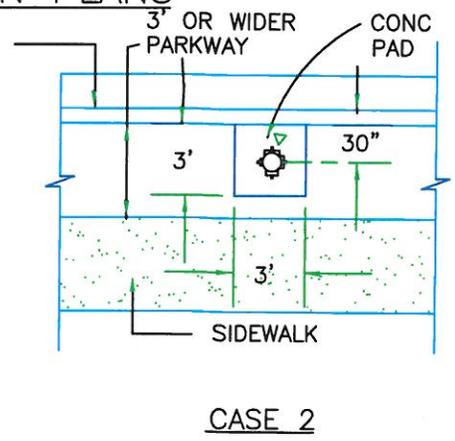

SIDEWALK NOT ADJACENT TO CURB

RESIDENTIAL FIRE HYDRANT INSTALLATION

REVISIONS		
NO.	DATE	APPROVED



CITY OF SAN JUAN CAPISTRANO

APPROVED *[Signature]* 9.17.12
 WATER ENGINEERING MANAGER DATE

STD. NO.
W-6