


**CONSTRUCTION NOTES**

1. PROVIDE AND INSTALL FIRE HYDRANTS PER SPECIFICATIONS SECTION 15139.
2. HYDRANTS TO BE PAINTED ACCORDING TO PAINT SPECIFICATIONS SECTION 09900.
3. PROVIDE SS316 "BREAK-AWAY" BOLTS AT HYDRANT FLANGE, BOLT HEAD DOWN.
4. ROTATE HYDRANT 45° WHEN ADJACENT TO POWER POLE OR STREET LIGHT POLE.
5. INSTALL WET BARREL HYDRANT ONLY. IF DIRECTED BY THE DISTRICT INSTALL A WET BARREL HYDRANT WITH A CHECK VALVE.
6. SET BACK DISTANCE PER TRAFFIC SET BACK REQUIREMENTS, OR 30" MINIMUM; WHICHEVER IS GREATER.

**HYDRANT LOCATION PLANS**

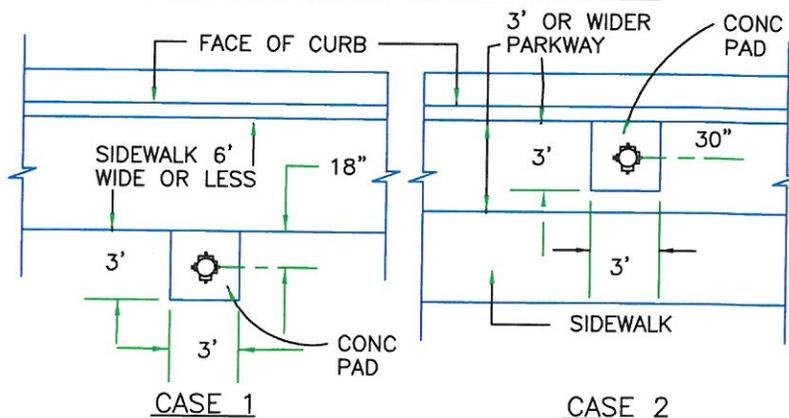

**CASE 1**  
SIDEWALK ADJACENT TO CURB

**CASE 2**  
SIDEWALK NOT ADJACENT TO CURB

**COMMERCIAL FIRE HYDRANT INSTALLATION**

REVISIONS		
NO.	DATE	APPROVED
1	03/06/92	RWC
2	08/11/92	RWC
3	02/04/93	RWC



**CITY OF SAN JUAN CAPISTRANO**

APPROVED *[Signature]* 9.17.2012  
WATER ENGINEERING MANAGER DATE

STD. NO.

**W-7**

SHEET 1 OF 1