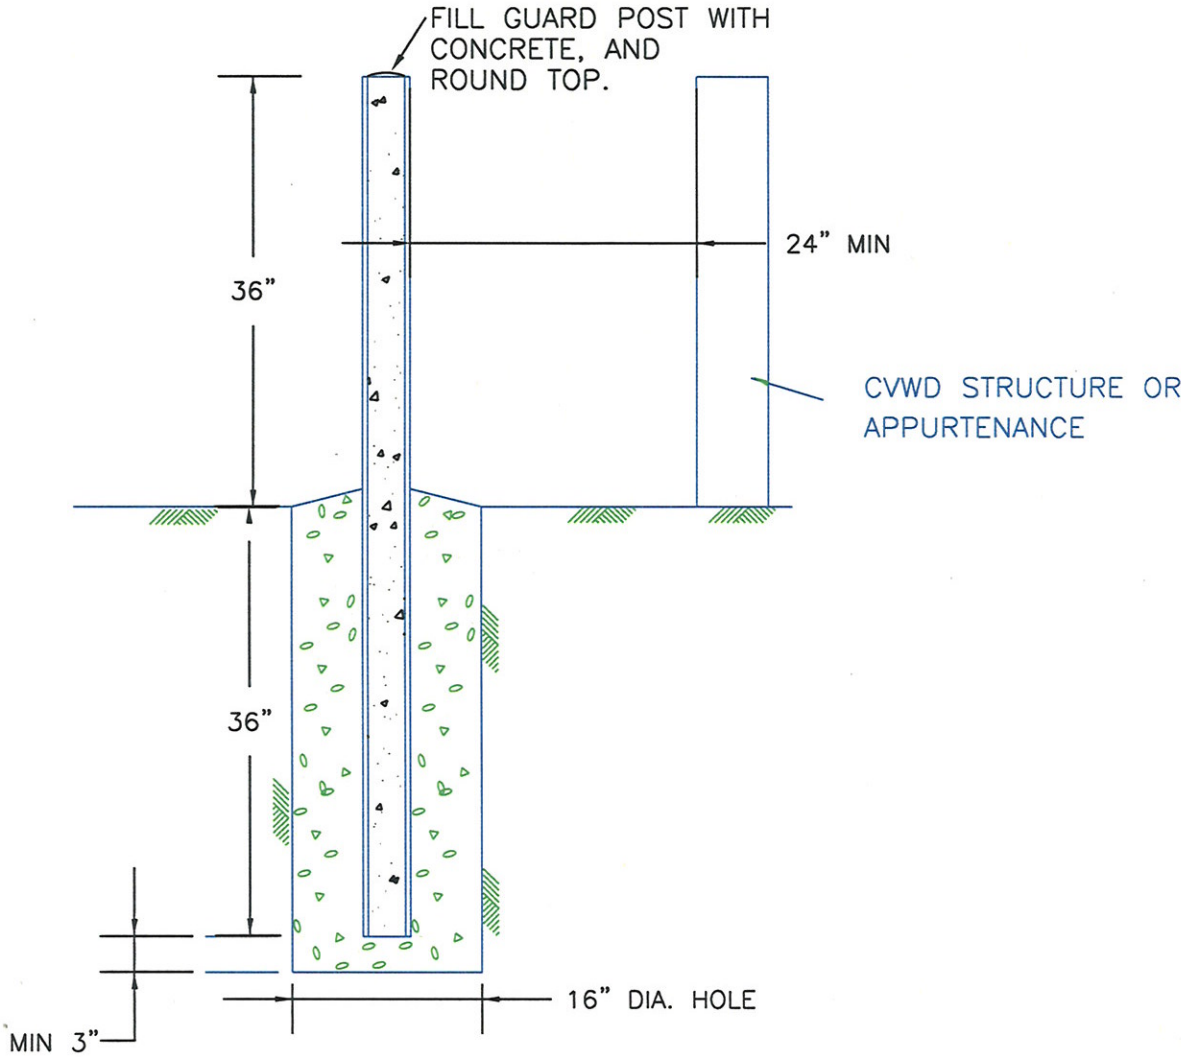

CONSTRUCTION NOTES

1. THE FACE OF THE GUARD POST SHALL BE A MINIMUM OF 24" FROM THE FACE OF THE CVWD STRUCTURE OR APPURTENANCE IT PROTECTS.
2. THE GUARD POST SHALL BE LOCATED SO THAT IT DOES NOT BECOME A TRAFFIC HAZARD, NOR SHOULD IT INTERFERE WITH THE OPERATION OF THE UTILITY APPURTENACE.
3. CONCRETE SHALL BE CLASS "B".
4. THE GUARD POST SHALL HAVE A NOMINAL DIAMETER OF 4 INCHES. AND SHALL HAVE A MINIMUM WALL THICKNESS OF 1/4 INCH.
5. PAINT GUARD POST OSHA SAFETY YELLOW PER STD 09900

GUARD POST FOR APPURTENANCES

REVISIONS		
NO.	DATE	APPROVED

CITY OF SAN JUAN CAPISTRANO

APPROVED

WATER SERVICES MANAGER — DATE 1.15.08

STD. NO. W-23

SHEET 1 OF 1

F:\CVWDSTD\W-23A