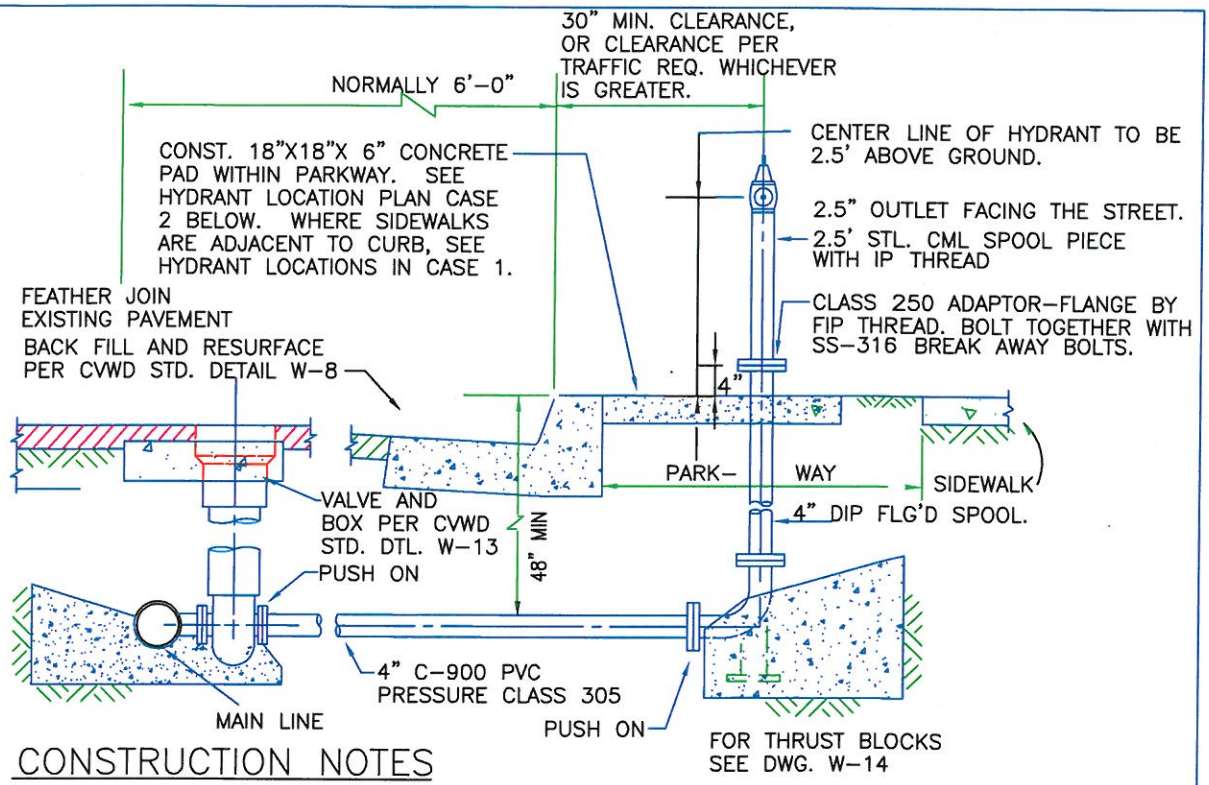

CONSTRUCTION NOTES

1 APPROVED HYDRANT, JONES J-344H.P., 4" X 2.5", ALL BRONZE HEAD.
2 HYDRANTS TO BE PAINTED PURPLE, ACCORDING TO PAINT SPECIFICATIONS SECTION 09900, AND SECTION 15151.
3 DO NOT LOCATE HYDRANT WITHIN 20' OF A POWER POLE, LIGHT POLE, AND OR ANOTHER FIRE HYDRANT.
4 HYDRANT SHALL BE SITUATED PER CASE 1 OR 2 BELOW, DEPENDING UPON THE SIDEWALK LOCATION.
5 CONNECT TO EXISTING MAIN BY MEANS OF A HOT TAP PER CVWD STD DETAIL W-22; OR CUT IN A TEE. (SEE CVWD SPECIFICATION SECTION 15100) WRAP TAPPING SLEEVE, VALVE AND PIPE IN 8 MIL POLYETHELYNE

HYDRANT LOCATION PLANS

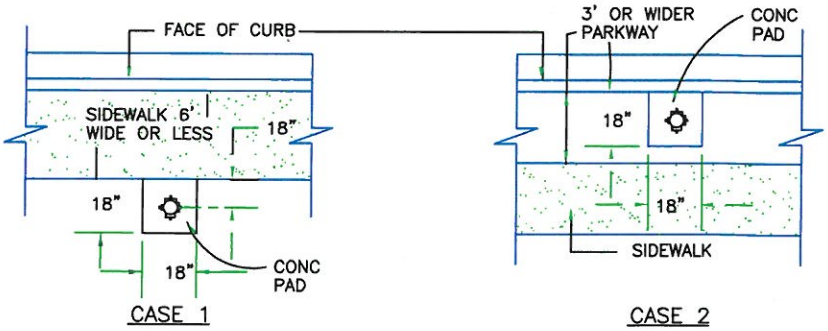

CASE 1

SIDEWALK ADJACENT TO CURB

CASE 2

SIDEWALK NOT ADJACENT TO CURB

NON-POTABLE WATER WHARF HEAD

REVISIONS		
NO.	DATE	APPROVED

CITY OF SAN JUAN CAPISTRANO

APPROVED

WATER ENGINEERING MANAGER — DATE 9.17.2012

STD. NO. W-25

SHEET 1 OF 1

F:\CVWDSTD\W-25A